



A
AT 11

FREeway CCTV POLE DETAIL

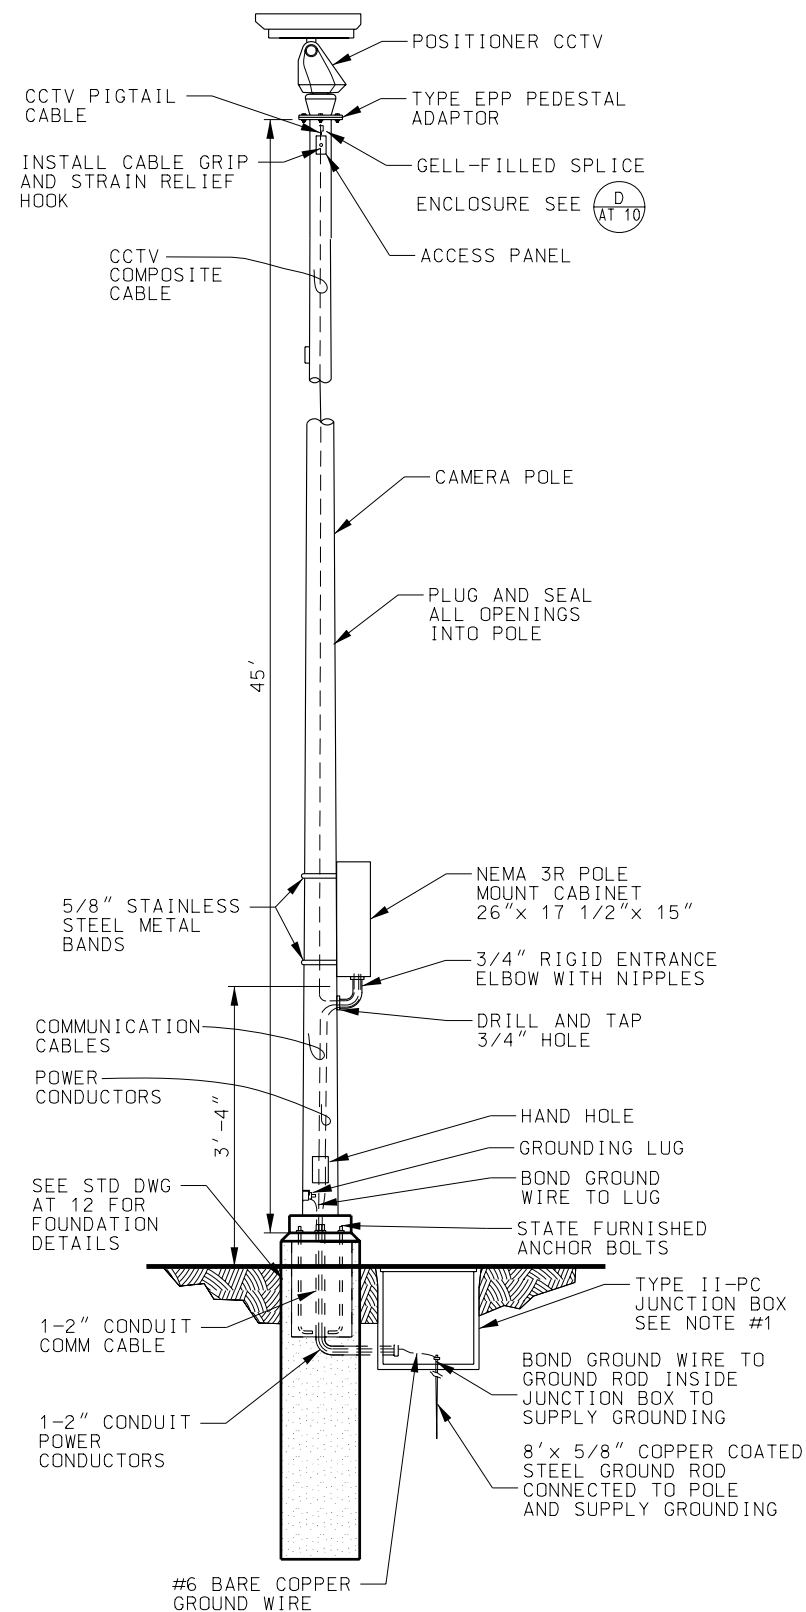

B FREeway CCTV Pole Detail
AT 11 WITH Pole Mount Cabinet

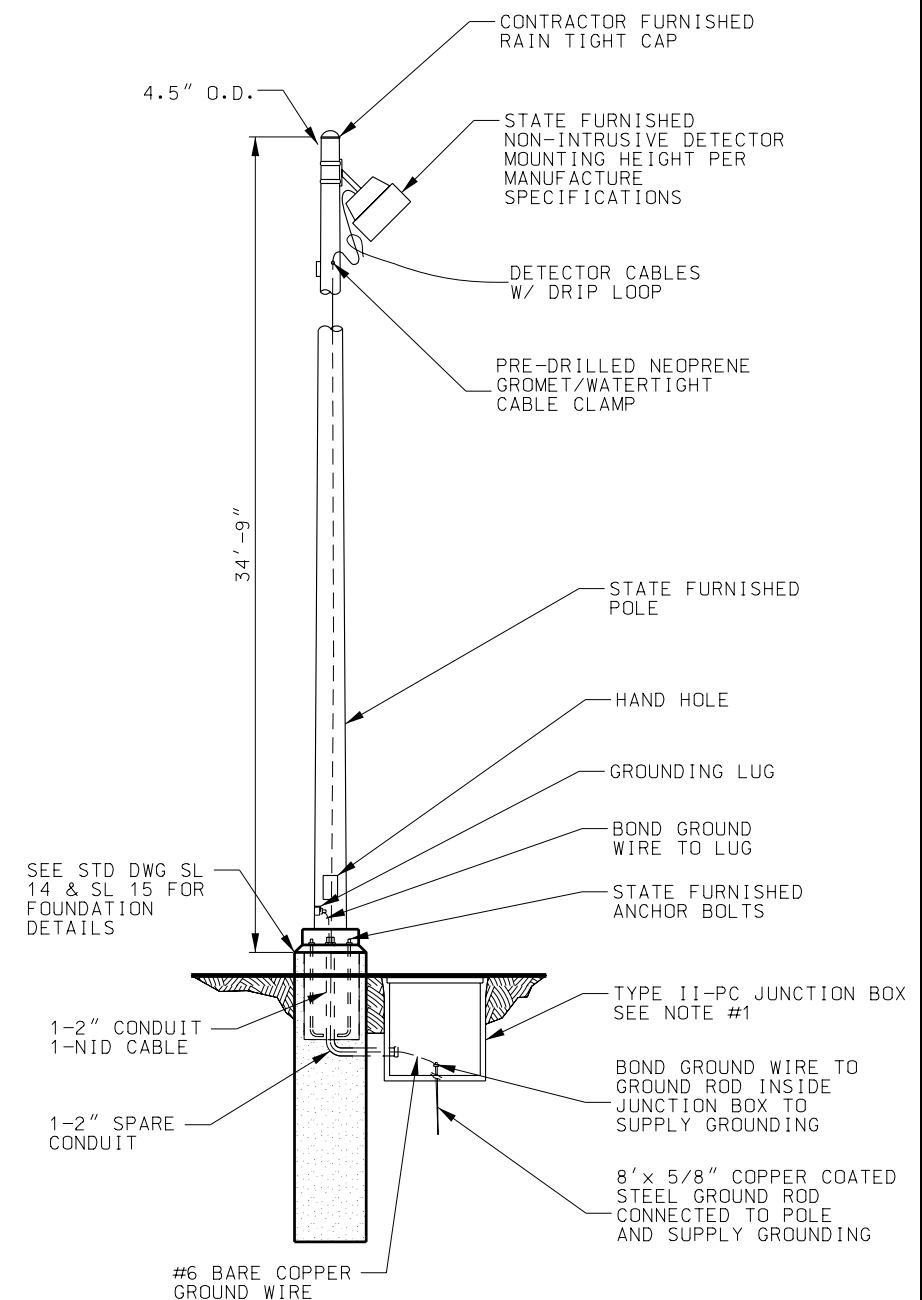

C LUMINAIRE POLE WITH NID
AT 11

NOTE:

1. JUNCTION BOX REQUIRED UNLESS POLE IS WITHIN 20' OF CONTROL CABINET.
2. REFER TO AT 10 FOR MOUNTING DETAILS.

[illegible]